




Class I Division 1 and 2, Groups A,B,C,D,T5



OVERFILL PROTECTION DEVICE  
MH61303  
CAN/ULC05661-10

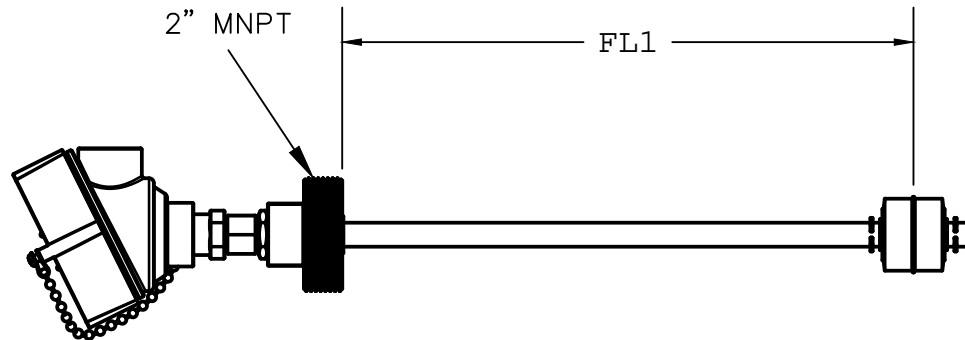

**HOUSING:** Nema 4X, Explosion Proof, Class 1, Div 1, Group C & D

**MAXIMUM PRESSURE:** 150 PSI

**OPERATING TEMPERATURE:** -20F ~ 250F

**FLOAT MATERIAL:** Stainless Steel

Switch Certified To:

CAN/CSA STD. C22.2 NO. 1010-1

CAN/CSA STD. C22.2 NO. 30

Conforms To:

UL1203 & ANSI/ISA S82-03

FLOAT LEVEL	FL1	ALBANY PUMP CO. LTD.	
FUNCTION	CRITICAL HIGH LEVEL		
HEIGHT FROM BOTTOM OF TANK (% OF TANK DEPTH)	%	DRWN. SMB	420 HARRY WALKER PARKWAY NEWMARKET, ONT. CANADA L3Y 8P5
NORMALLY OPEN (NO)/ NORMALLY CLOSED (NC)	NC	SCALE NONE	FUEL OIL ACCESSORIES
WIRE COLOUR	BROWN	CHK'D	LEVCON 1 CLIS
		This drawing and the information depicted therein is the property of Albany Pump Co. Ltd. Copies are issued in strict confidence and shall not be reproduced, copied or used as the basis for the manufacture or sale of products without prior written permission of Albany Pump Co.	